



TEST REPORT

No. : XMIN180400683CCM

Date : Apr.28, 2018

Page: 1 of 3

CUSTOMER NAME: HYDROBLOK GRAND INTERNATIONAL LTD
ADDRESS: 301-20338 65TH AVENUE, LANGLEY, BC V2Y 2X3

Sample Name : TILE BACKER BOARD
Material : Extruded Polystyrene Foam
Buyer : HYDROBLOK GRAND INTERNATIONAL LTD
Manufacturer : HYDROBLOK GRAND INTERNATIONAL LTD

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

Test Required : Selected test(s) as requested by applicant
Date of Receipt : Apr.19, 2018
Testing Start Date : Apr.19, 2018
Testing End Date : Apr.28, 2018
Test Result(s) : For further details, please refer to the following page(s)
(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

***** To be continued*****

Signed for
SGS-CSTC Standards Technical
Services Co., Ltd. XM Branch

Civi Huang Authorized Signatory



SGS-CSTC Standards Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN180400683CCM

Date : Apr.28, 2018

Page: 2 of 3

Resistance of concrete to rapid freezing and thawing

Test Method:

Refer to ASTM C666-15 Standard Test Method for Resistance of Concrete to Rapid Freezing and Thawing - Procedure B

Specimens: 276mm×76mm×12mm, 5pcs, see the photo(s)

Preconditioning: The specimens shall be immersed in water for 48h.

Freezing and thawing cycle:

Each cycle consists of a 3h freezing period in air, followed by a 1h thawing period during which the specimens are immersed in water, and as follows:

Water saturated specimens are placed into the freezer. The temperature shall be reached (-18 ± 2) °C in 2h, then the specimens shall be placed in the freezer for 1h;

Then the frosted specimens are immersed in water at (18 ± 2) °C. When this temperature is reached, the specimens shall be immersed for 1h;

Repeat the above freezing and thawing cycle 25 times.

Test Result:

Specimens identification No.	1	2	3	4	5
Length change (%)	0.00	-0.02	0.03	-0.01	-0.01
Observations	All of the specimens have be stained by water, see the photo(s)				

Note: Length change=(length after test- length before test)/length before test×100%.

***** To be continued*****




TEST REPORT

No. : XMIN180400683CCM

Date : Apr.28, 2018

Page: 3 of 3

Specimen photograph(s):

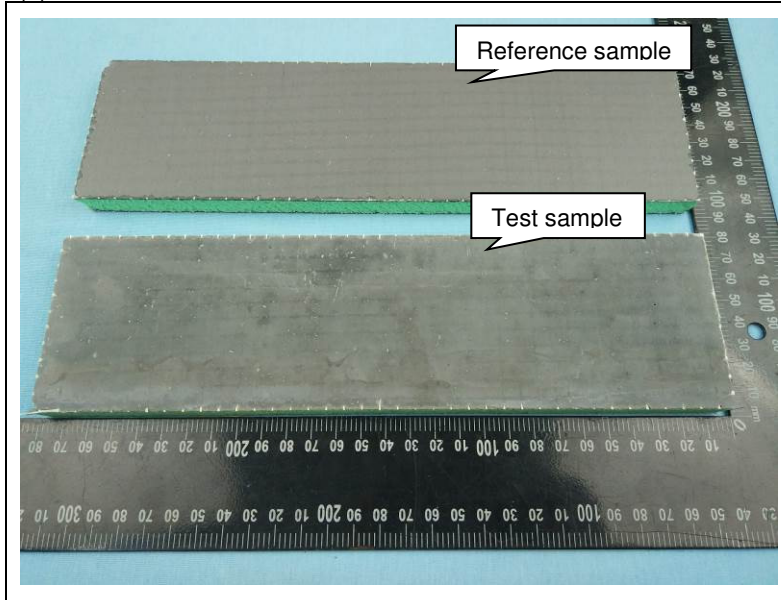

SGS authenticate the photo(s) on original report only

*****End of report*****

